


# OHRIEVAČE LOGITEX LX ACDC/M+K ABC 100, 125, 160, 200 I

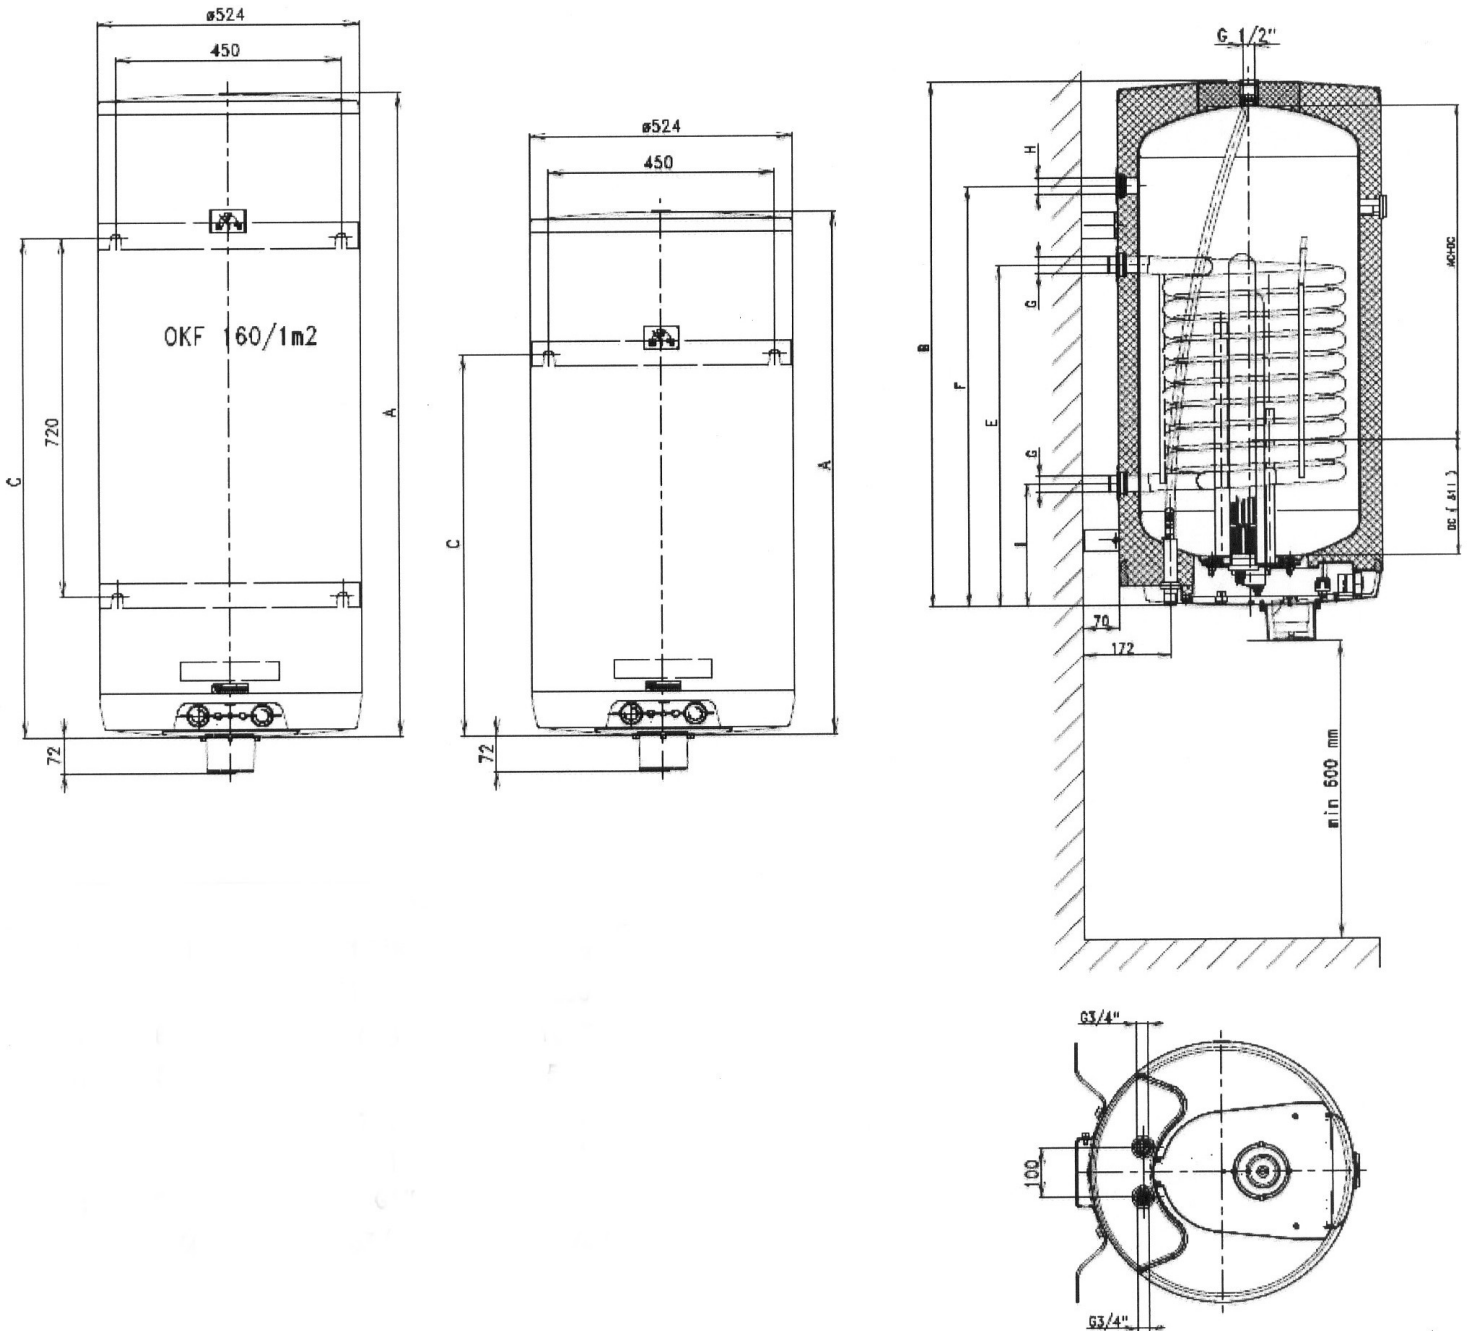

| Typ | LX ACDC/M+K 100 ABC | LX ACDC/M+K 125 ABC | LX ACDC/M+K 160 ABC | LX ACDC/M+K 200 ABC |
|-----|---------------------|---------------------|---------------------|---------------------|
| A   | 881                 | 1046                | 1235                | 1287                |
| B*  | 876                 | 1041                | 1230                | 1282                |
| C   | 636                 | 801                 | 1005                | 793                 |
| D   | 524                 | 524                 | 524                 | 584                 |
| E   | 701                 | 701                 | 701                 | 685                 |
| F   | 551                 | 551                 | 831                 | 895                 |
| G   | G1"                 | G1"                 | G1"                 | G1"                 |
| H   | G3/4"               | G3/4"               | G3/4"               | G3/4"               |
| I   | 211                 | 261                 | 261                 | 245                 |
| J   | /                   | /                   | 815                 | 600                 |

**B\* = Vzdialenosť od hornej hrany ohrievača ku koncu rúr vstupu a výstupu vody.  
Rozmery pred vŕtaním overiť!**